

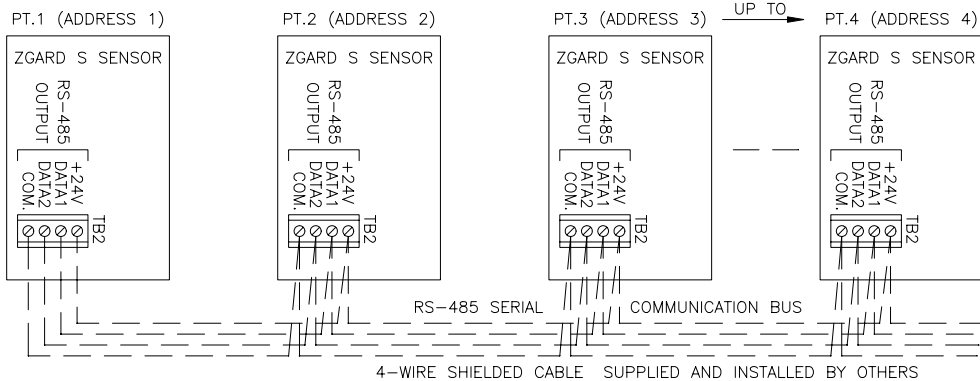
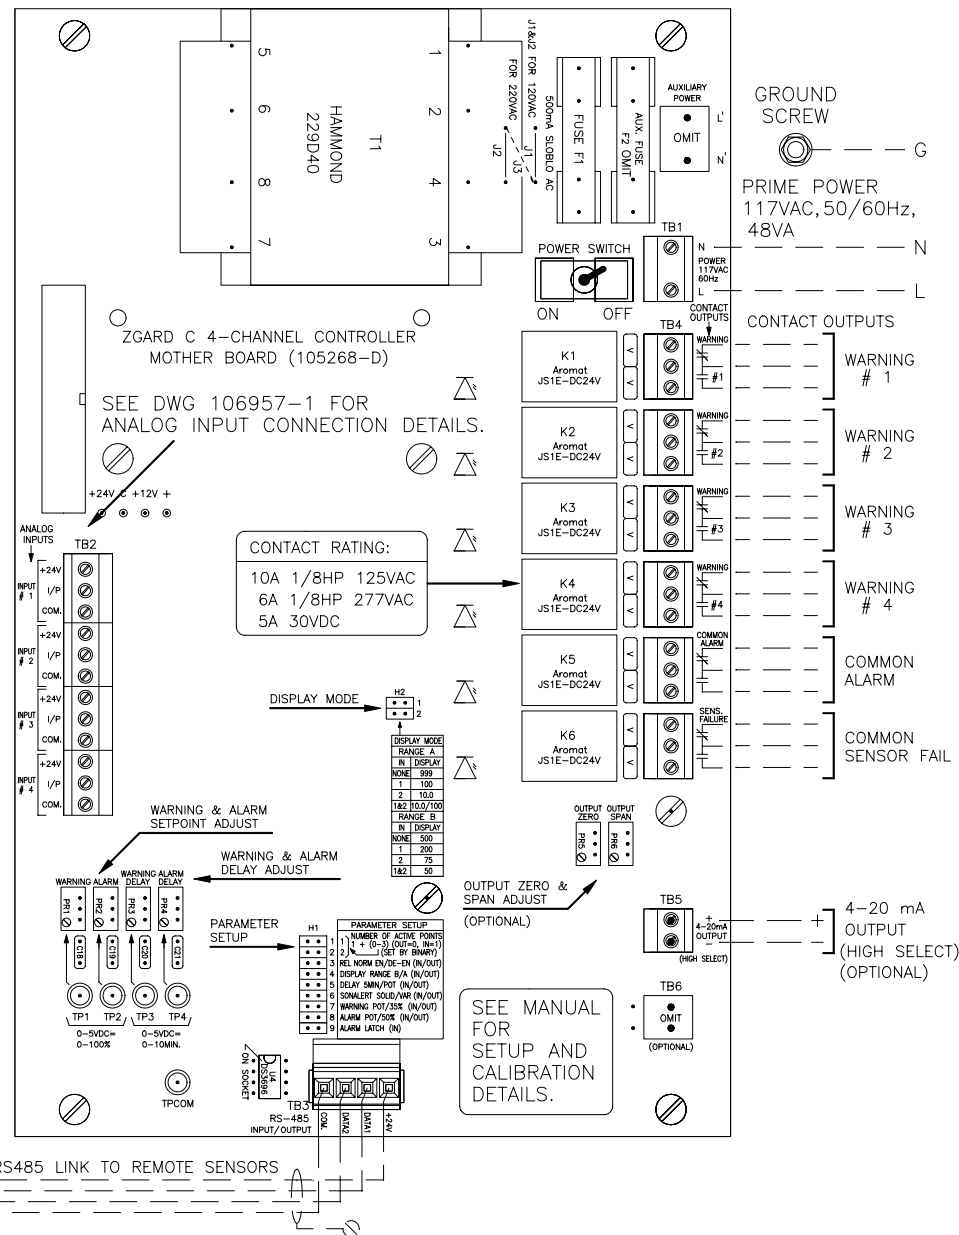


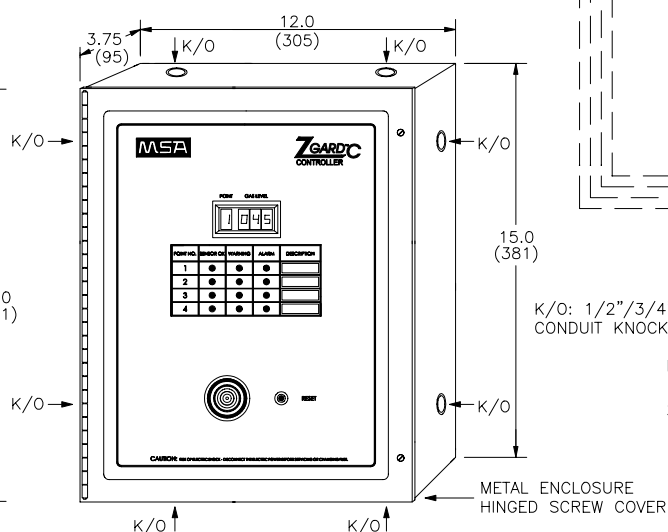

FOR DAISY-CHAIN (SERIES) WIRING OF ZGARD S SENSORS TO THE ZGARD C CONTROLLER AS SHOWN HERE, EACH SENSOR MUST BE UNIQUELY ADDRESSED VIA JUMPERS ON SENSOR CIRCUIT BOARD.

CABLE LENGTH VS. SIZE (AWG#)				
CABLE LENGTH FEET	No. OF SENSORS	2	3	4
1 TO 500	AWG #	22	22	22
501 TO 1,000	AWG #	22	22	22
1,001 TO 1,500	AWG #	20	20	20
1,501 TO 2000	AWG #	18	18	18

SUGGESTED CABLE	
GAUGE (AWG#)	4-WIRE SHIELDED CABLE
22	ALPHA WIRE 5504
20	ALPHA WIRE 5514
18	ALPHA WIRE 5524
16	ALPHA WIRE 5534

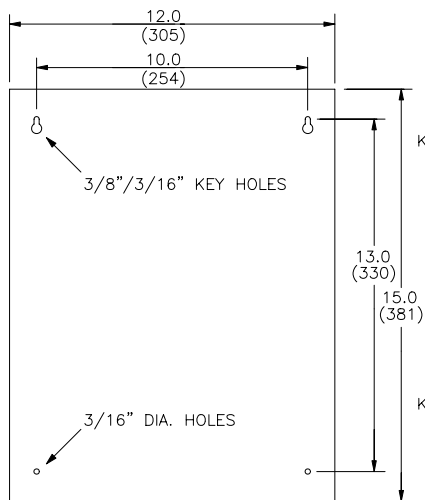

- NOTES:
1. DIMENSIONS SHOWN IN INCHES (MILLIMETERS).
2. SYSTEM MAY CHANGE TO IMPROVE PERFORMANCE.

MSA

CHKD: DATE: Jan. 26/05 DRN: KS

**ZGARD C 4-Channel Controller
Installation Outline for
RS-485 Digital Signal Type Sensors**

DWG. NO.: 106957-2 REV. A