

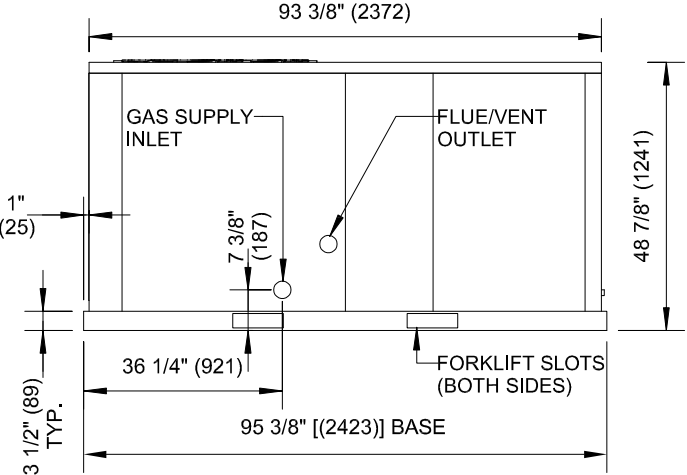


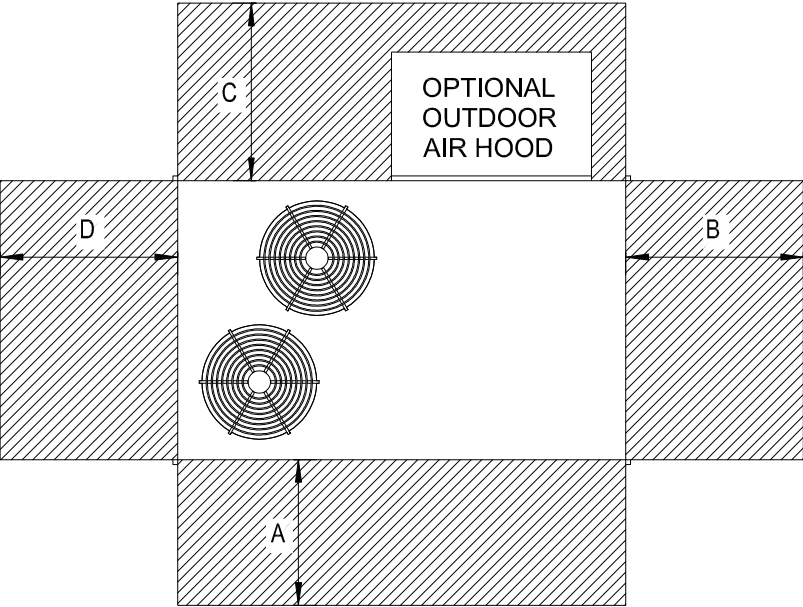


FRONT VIEW

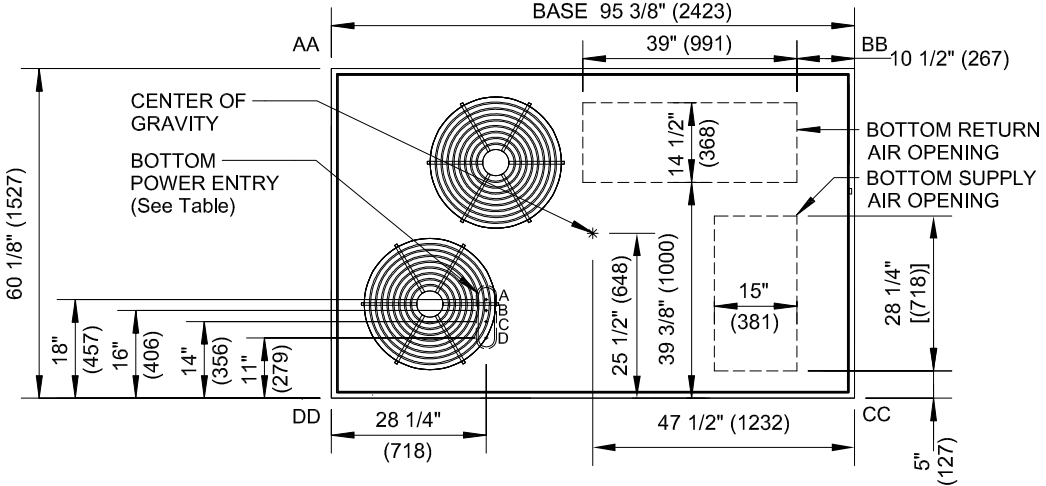


TOP VIEW (Base)

BOTTOM POWER ENTRY			
Holes required for Optional Bottom Power Entry Kit			
	Threaded Conduit Fittings (Provided in Kit)	Wire Use	Hole Diameter Required in Unit Base (Max.)
A	1/2	ACC	7/8 (23)
B	1/2	24V	7/8 (23)
C	1-1/4	POWER	1-3/4 (44)
D	3/4	AUX	1-3/4 (44)

1 Unit Clearance	A		B		C		D		Top Clearance
	in.	mm	in.	mm	in.	mm	in.	mm	
Service Clearance	60	1524	36	914	36	914	60	1524	Unobstructed
Clearance to Combustibles	36	914	1	25	1	25	1	25	
Minimum Operation Clearance	36	914	36	914	36	914	36	914	

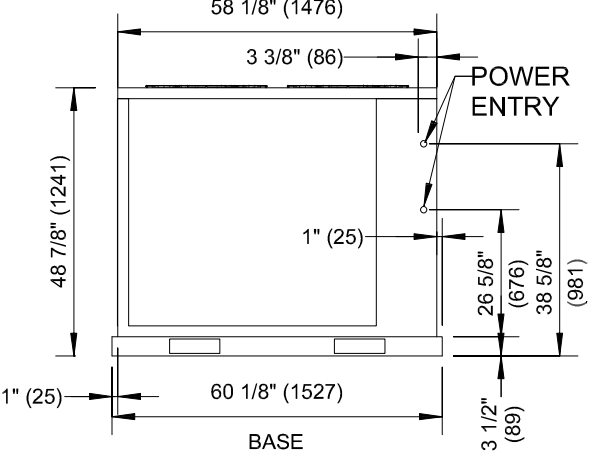

END VIEW

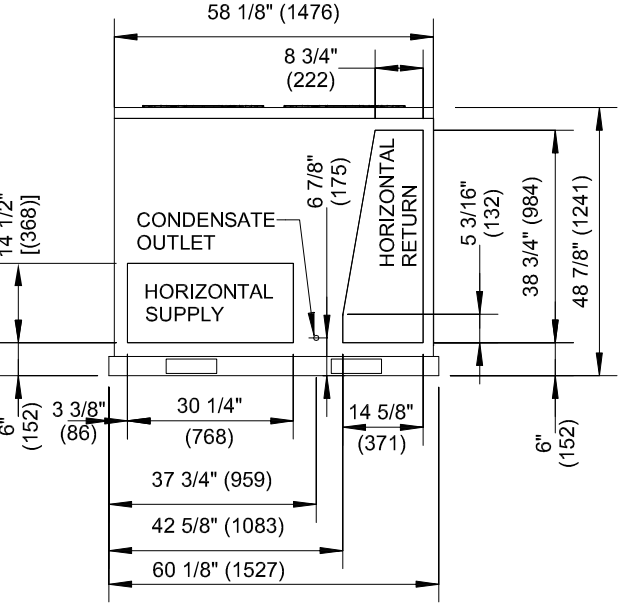


END VIEW

NOTE - Entire perimeter of unit base requires support when elevated above the mounting surface.

¹ Service Clearance - Required for removal of serviceable parts.

Clearance to Combustibles - Required for clearance to combustible material.

Minimum Operation Clearance - Required clearance for proper unit operation.

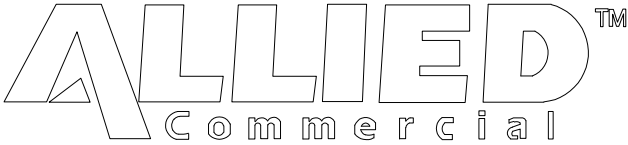

Z-Series Packaged Electric/Electric Rooftop Units

Series: Z-Series

Nominal Cooling Capacity (Tons): 7_5-12_5 Tons

Model: ZGD

ZGD

Scale: N.T.S.