



ENERGY RECOVERY SYSTEM FOR XION™ ROOFTOP UNITS - 60 Hz

COMMERCIAL PRODUCT SPECIFICATIONS


Bulletin No. 211018
October 2022



300 to 6200 cfm Capacity


MODEL NUMBER IDENTIFICATION

50 R 06 44 x H 23 (Factory Options) (See below)

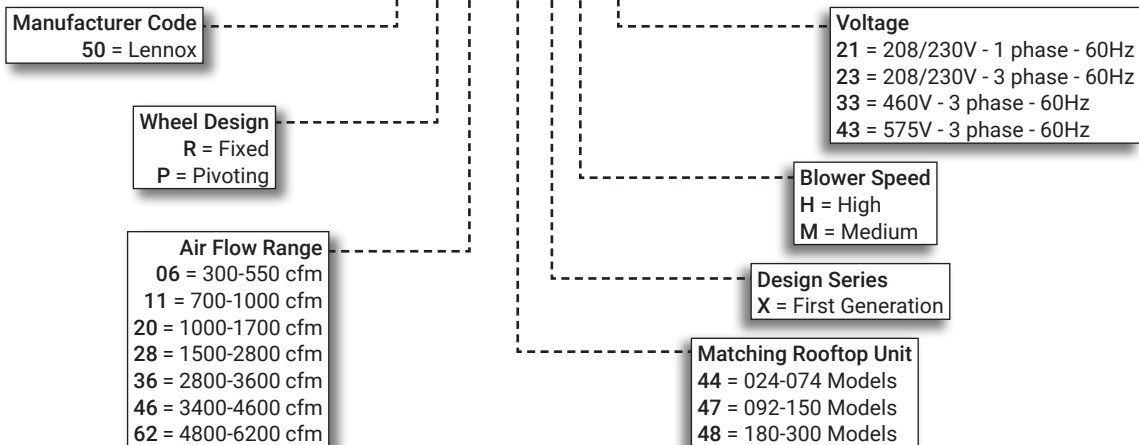

Factory Option Codes

L M E S P R D V F F E

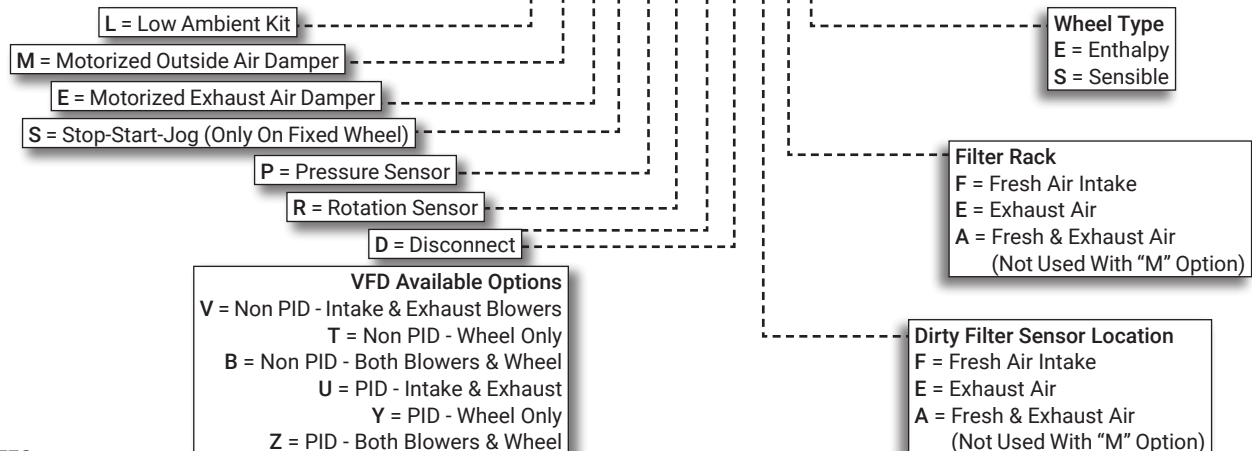

NOTES:

x = Factory Option Not Selected e.g. 50R0644xH23LxESxRDxBExE

ERS is a Fixed wheel with 300-550 CFM for 024-074 models with a Low Ambient Kit, Motorized Exhaust Air Damper, Stop-Start Jog, Rotation Sensor, Disconnect, VFD - Non PID, Dirty Filter Sensor in Exhaust Air and an Enthalpy Wheel.

CONTENTS

Dimensions	9
Electrical Data	8
Approvals And Warranty	2
Features And Benefits	2
Guide Specifications	12
Model Number Identification.	1
Options / Accessories - Order Separately	14
Specifications	4
- 2 To 6 Ton Xion Models	4
- 7.5 To 12.5 Ton Xion Models	5
- 15 To 25 Ton Xion Models	6
Unit Clearances	10

FEATURES AND BENEFITS

APPLICATIONS

The Lennox Energy Recovery System (ERS) is a constant volume, energy recovery ventilator that is directly coupled with Lennox Xion™ rooftop units. Its primary function is to increase overall HVAC system efficiency and to reduce long-term energy costs.

This is accomplished by capturing both sensible and latent energy from either the exhaust or intake air stream and transferring it to the other, resulting in reduced cooling loads at design temperatures up to four tons per 1000 cfm of outside air and reduced heating loads up to 12,000 Btuh per 400 cfm of outside air.

The recovery wheel provides sensible and latent energy exchange between the entering and exhaust air streams of a building allowing a substantial amount of the energy, which is normally lost in the exhaust air stream, to be returned into the entering air.

Each unit factory test operated to ensure proper operation.

OPERATION

- The enthalpy wheel contains parallel layers of a polymeric material that is physically embedded with a silica gel (desiccant)
- The wheel is located in the intake and exhaust air streams of the ventilation equipment
- As the wheel rotates through each air stream, the wheel surface captures sensible and latent energy
- In the heating mode, the wheel rotates to provide a constant transfer of heat from the exhaust air stream to the colder intake air stream
- During the cooling season, the process is reversed
- When used in conjunction with a rooftop unit equipped with an economizer, on pivoting models, the wheel pivots out of the air stream to allow the economizer to operate normally for "free cooling" when outdoor temperature and humidity is acceptable
- By pivoting the wheel out of the air stream, the system can utilize 100% of the rooftop unit's blower capabilities
- During economizer operation, the exhaust blower continues to run, providing power exhaust for the system
- The intake blower is de-energized during economizer operation

APPROVALS AND WARRANTY

APPROVALS

- Rated in accordance with AHRI standard 1060-2005
- To obtain a copy of the Standard or to view Lennox' latest certified data, please visit the AHRI web site at <http://www.ahrinet.org>
- ETL Certified per UL 1995 and CSA/CAN C22.2 No. 236

WARRANTY

- Recovery Wheel - limited warranty for five years
- All other covered components - one year limited warranty

ERS SELECTION

- **Step One** - Determine the air conditioning load requirements using the required amount of outside air without an ERS
- **Step Two** - Select the proper ERS for the outside air requirements and calculate the tonnage reduction.
- Select the rooftop unit required by reducing the load determined in step one by the reduction in step two
- Example: If the load in Step 1 was 10 tons, and the reduction in Step 2 was 2.5 tons, select a 7.5 ton unit.
- Select the proper ERS based on the selected unit

NOTE - The height of the roof top unit curb MUST correspond with the required curb height needed for the ERS. See Specifications Table.

SYSTEM FEATURES

- Low-voltage logic board used to control frost protection and motorized outside air damper
- Low-voltage terminal strip
- Barometric relief dampers provided standard on all ERS units
- Balancing dampers provided standard on all fixed wheel ERS units
- Metal-mesh, mist-eliminator-type filters provided in intake air hood
- Separate, fused power supply
- Continuous operation down to 10°F without defrost at indoor relative humidity up to 40%
- For temperatures below 10°F an optional, factory installed Low Ambient Control Kit is required

FEATURES AND BENEFITS

RECOVERY WHEEL

AirXchange™ Enthalpy Wheels

- Capable of both sensible and latent heat recovery
- Dry energy transfer
- Moisture in supply air stream is transferred to exhaust air stream in vapor state, eliminating condensate plumbing in the ventilator
- Constructed of lightweight polymer material and coated with a desiccant silica gel that will not dissolve or liquefy in the presence of water or high humidity
- Wheels 25 in. and larger in diameter are segmented for easy removal. Wheels less than 25 in. in diameter are removed from cabinet in a slide-out cassette
- Patented, pivoting-wheel option allows unit to operate in true economizer mode when the outside temperature is suitable for cooling
- Pivoting the wheel out of the air stream during economizer mode allows efficiencies to be maximized by reducing demand on the supply fan motor

BLOWERS

- Centrifugal, forward curved blowers provided for high-static capability and low sound levels
- Belt-drive blowers have permanently lubricated ball bearings, overload protection, and adjustable sheaves for blower speed adjustment

CABINET

- Fully insulated with non-hygroscopic fiberglass insulation. Constructed of galvanized steel and finished with electro-statically bonded powdered enamel coating to withstand 1000 hour salt-spray test per ASTM B117
- Attaches directly to the rooftop unit
- All mounting hardware is provided
- Adjustable support legs are provided

Options / Accessories

Factory Installed

Low Ambient Control Kit

- Prevents frost formation on energy wheel heat transfer surfaces by terminating the intake blower operation when discharge air temperature falls below a field-selectable temperature setting
- Intake blower operation resumes after temperature rises above the adjustable temperature differential. Kit includes temperature sensor

Motorized Outside Air Damper

- Damper mounts behind the outside air intake hood and opens when the ERS is energized and closes when de-energized

Motorized Exhaust Air Damper

- Damper mounts in the barometric relief hood and opens when the ERS is energized and closes when de-energized

Stop-Start-Jog (Fixed Models Only)

- Control option that allows intermittent operation of the enthalpy wheel during mild outdoor conditions to provide cycling and cleaning of the wheel

Pressure Sensor

- Measures the amount of outside airflow across the enthalpy wheel

Rotation Sensor

- Verifies the rotation of the enthalpy wheel

Disconnect

- Optional field device used to provide easy ability to switching the power on and off to the ERS
- Must be field wired

VFD Blower Control

- Variable frequency drives are available to control the speed of the blowers only
- These VFD's can be integrated with a building automation system to deliver precisely the amount of air needed to maximize efficiencies

Dirty Filter Sensor

- The dirty filter sensor sends a signal to field wired alarm when filters need to be cleaned or changed

Filter Rack

- Filter racks filter air in both the intake and exhaust sections of ERS

Energy Recovery Wheel - Sensible Type

- Sensible Wheel type is used for sensible heat recovery

Field Installed

ERS Support

- 8 inch high base for support of the exhaust and intake end of the ERS
- Available in 48, 60, 76 inch lengths
- See Page 14 for model numbers

ERS Roof Curb

- Used to support RTU and raise them to the correct height for mounting
- See Page 14 for model numbers

GFI Service Outlet

- Optional field powered service outlet provides power for service equipment
- Must be field installed and wired
- See Page 14 for model numbers

NOTE - Contact your local Lennox Commercial Sales Representative for ordering information.

SPECIFICATIONS				2 TO 6 TON XION MODELS							
General Data	Model Number Fixed Wheel		² 50R0644xH			50R1144xH			50R2044xH		
	Model Number Pivoting Wheel		- - -			50P1144xH			50P2044xH		
	Nominal Air Volume - cfm		300-550			700-1000			1000-1700		
	Matching Units		Xion 024-060 models					Xion 074 models			
Required Height of Rooftop Unit Curb - in.				14			14			24	
Fresh Air Blower	Motor - hp		0.2			1/2			1		
	Wheel Size (diameter x width) - in		6-1/4 x 6-1/2			10 x 6			9 x 9		
	Motor Speed - rpm		1780			1120			1725		
	Motor Speed(s)		2			3			Adjustable Sheave		
	Bearing Type		Sleeve			Sleeve			Ball		
Exhaust Air Blower	Motor Type		PSC			PSC			Belt Drive		
	Motor - hp	Fixed Wheel	1/4			1/2			1		
		Pivoting Wheel	- - -			1/2			1-1/2		
	Wheel Size (diameter x width) - in		6-1/4 x 6-1/2			10 x 6			9 x 9		
	Motor Speed - rpm		1780			1120			1725		
	Motor Speed(s)		2			3			Adjustable Sheave		
	Bearing Type		Sleeve			Sleeve			Ball		
	Recovery Wheel	Wheel Depth x Diameter - in		2 x 19-1/4			3 x 25-1/4			3 x 30-5/16	
		Motor Speed - rpm		1050			1050			1050	
Electrical Data - Line Voltage - 60Hz				² 208/230V-1ph, 208/230V-3ph, 460V-3ph, and 575V-3ph			208/230V-3ph, 460V-3ph, and 575V-3ph			208/230V-3ph, 460V-3ph, or 575V-3ph	
Enthalpy Wheel Airflow Data	EATR - Exhaust Air Transfer Ratio	Nominal Airflow	500 cfm at 0.6 in. w.c.			900 cfm at 1 in. w.c.			1600 cfm at 0.95 in. w.c.		
		at minus 1 in. w. c.	9.90%			9.30%			7.80%		
		at 0 in. w.c.	0.20%			0.70%			0.40%		
		at 1 in. w.c.	0.00%			0.00%			0.00%		
	OACF - Outdoor Air Correction Factor	at minus 1 in. w. c.	1.02%			0.97%			0.97%		
		at 0 in. w.c.	1.33%			1.19%			1.16%		
		at 1 in. w.c.	1.59%			1.34%			1.29%		
¹ Thermal Ratings at 0 in. w.c. Pressure Differential	Total Effectiveness	100% Airflow Heating	Sensible	Latent	Total	Sensible	Latent	Total	Sensible	Latent	Total
		75% Airflow Heating	68%	60%	65%	76%	68%	73%	68%	61%	65%
		100% Airflow Cooling	73%	65%	70%	81%	73%	78%	72%	67%	71%
		75% Airflow Cooling	68%	60%	64%	76%	68%	72%	68%	61%	64%
			73%	65%	69%	81%	73%	76%	72%	67%	70%
	Net Effectiveness	100% Airflow Heating	68%	60%	65%	76%	68%	73%	68%	61%	65%
		75% Airflow Heating	73%	65%	70%	81%	73%	78%	72%	67%	71%
		100% Airflow Cooling	68%	60%	64%	76%	68%	72%	68%	61%	64%
		75% Airflow Cooling	73%	65%	69%	81%	73%	76%	72%	67%	70%
	³ Weights	Fixed	Shipping Weight - lbs.	472			475			791	
			Net Weight - lbs.	455			458			706	
Pivoting		Shipping Weight - lbs.	- - -			480			754		
		Net Weight - lbs.	- - -			463			669		

¹ Rated in accordance with AHRI Standard 1060-2005. For further information, please reference AHRI 1060-2005 Standard for Rating Air-to-Air Heat Exchangers For Energy Recovery Ventilation Equipment.

² A unit step-down transformer is provided, 208/230/460/575V primary, 120V secondary.

³ Actual weight may vary and is dependent on configuration.

SPECIFICATIONS				7.5 TO 12.5 TON XION MODELS															
General Data		Model Number Fixed Wheel		50R2047xH			50R2847xM			50R2847xH			50R3647xH						
		Model Number Pivoting Wheel		50P2047xH			50P2847xM			50P2847xH			50P3647xH						
		Nominal Air Volume - cfm		1000-1700			1500-2200			2200-2800			2800-3600						
Matching Units				Xion 092 through 150 models															
Required Height of Rooftop Unit Curb - in.				14			14			14			24						
Fresh Air Blower		Motor - hp		1			1-1/2			1-1/2			2						
		Wheel Size (diameter x width) - in		9 x 9			10 x 10			10 x 10			12 x 9						
		Motor Speed - rpm		1725			1725			1725			1725						
		Motor Speed(s)		Adjustable Sheave			Adjustable Sheave			Adjustable Sheave			Adjustable Sheave						
		Bearing Type		Ball			Ball			Ball			Ball						
Exhaust Air Blower		Motor Type		Belt-Drive			Belt-Drive			Belt-Drive			Belt-Drive						
		Motor - hp		Fixed Wheel		1			1-1/2			1-1/2			2				
				Pivoting Wheel		1-1/2			3			3			3				
		Wheel Size (diameter x width) - in		9 x 9			10 x 10			10 x 10			12 x 9						
		Motor Speed - rpm		1725			1725			1725			1725						
		Motor Speed(s)		Adjustable Sheave			Adjustable Sheave			Adjustable Sheave			Adjustable Sheave						
		Bearing Type		Ball			Ball			Ball			Ball						
Recovery Wheel		Wheel Depth x Diameter - in		3 x 30-11/32			3 x 37-3/4			3 x 37-3/4			3 x 41-13/16						
		Motor Speed - rpm		1050			825			825			1075						
Electrical Data - Line Voltage - 60Hz				208-230V - 3ph, 460V - 3ph or 575V - 3ph			208-230V - 3ph, 460V - 3ph or 575V - 3ph			208-230V - 3ph, 460V - 3ph or 575V - 3ph			208-230V - 3ph, 460V - 3ph or 575V - 3ph						
Enthalpy Wheel Airflow Data		Nominal Airflow		1600 cfm at 0.95 in. w.c.			1500 cfm at 0.67 in. w.c.			2600 cfm at 0.95 in. w.c.			3100 cfm at 0.9 in. w.c.						
		EATR - Exhaust Air Transfer Ratio		at minus 1 in. w. c.		7.80%			6.10%			6.10%			4.90%				
				at 0 in. w.c.		0.40%			4.00%			4.00%			1.30%				
				at 1 in. w.c.		0.00%			0.00%			0.00%			0.30%				
		OACF - Outdoor Air Correction Factor		at minus 1 in. w. c.		0.97%			0.98%			0.98%			0.99%				
				at 0 in. w.c.		1.16%			1.13%			1.13%			1.07%				
				at 1 in. w.c.		1.29%			1.23%			1.23%			1.12%				
¹ Thermal Ratings at 0 in. w.c. Pressure Differential				Sensible	Latent	Total	Sensible	Latent	Total	Sensible	Latent	Total	Sensible	Latent	Total				
				Total Effectiveness		100% Airflow Heating		68%	62%	65%	68%	60%	65%	68%	60%	65%	68%	60%	65%
						75% Airflow Heating		72%	67%	71%	74%	67%	71%	74%	67%	71%	74%	67%	71%
				Net Effectiveness		100% Airflow Cooling		68%	61%	64%	68%	60%	63%	68%	60%	63%	68%	60%	63%
						75% Airflow Cooling		72%	67%	70%	74%	67%	70%	74%	67%	70%	74%	67%	70%
				Total Effectiveness		100% Airflow Heating		68%	61%	65%	68%	60%	65%	68%	60%	65%	68%	60%	65%
						75% Airflow Heating		72%	67%	71%	74%	67%	71%	74%	67%	71%	74%	67%	71%
				Net Effectiveness		100% Airflow Cooling		68%	61%	64%	68%	60%	63%	68%	60%	63%	68%	60%	63%
75% Airflow Cooling		72%	67%			71%	74%	67%	70%	74%	67%	70%	74%	67%	70%				
³ Weights		Fixed		Shipping Weight - lbs.		791			811			811			1120				
				Net Weight - lbs.		706			726			726			1045				
		Pivoting		Shipping Weight - lbs.		754			928			928			1125				
				Net Weight - lbs.		669			843			843			1050				

¹ Rated in accordance with AHRI Standard 1060-2005. For further information, please reference AHRI 1060-2005 Standard for Rating Air-to-Air Heat Exchangers For Energy Recovery Ventilation Equipment.

² A unit step-down transformer is provided, 208/230/460/575V primary, 120V secondary.

³ Actual weight may vary and is dependent on configuration.

SPECIFICATIONS			15 TO 25 TON XION MODELS								
General Data	Model Number Fixed Wheel		50R2848xM			50R2848xH			50R3648xH		
	Model Number Pivoting Wheel		50P2848xM			50P2848xH			50P3648xH		
	Nominal Air Volume - cfm		1500-2200			2200-2800			2800-3600		
	Matching Units		Xion 180 through 300 models								
Required Height of Rooftop Unit Curb - in.			14			14			14		
Fresh Air Blower	Motor - hp		1-1/2			1-1/2			2		
	Wheel Size (diameter x width) - in		10 x 10			10 x 10			12 x 9		
	Motor Speed - rpm		1725			1725			1725		
	Motor Speed(s)		Adjustable Sheave			Adjustable Sheave			Adjustable Sheave		
	Bearing Type		Ball			Ball			Ball		
Exhaust Air Blower	Motor Type		Belt-Drive			Belt-Drive			Belt-Drive		
	Motor - hp	Fixed Wheel	1-1/2			1-1/2			2		
		Pivoting Wheel	3			3			3		
	Wheel Size (diameter x width) - in		10 x 10			10 x 10			12 x 9		
	Motor Speed - rpm		1725			1725			1725		
	Motor Speed(s)		Adjustable Sheave			Adjustable Sheave			Adjustable Sheave		
	Bearing Type		Ball			Ball			Ball		
	Recovery Wheel	Wheel Depth x Diameter - in		3 x 37-3/4			3 x 37-3/4			3 x 41-13/16	
Motor Speed - rpm		825			825			1075			
Electrical Data - Line Voltage - 60Hz			208-230V - 3ph / 460V - 3ph / 575V - 3ph								
Enthalpy Wheel Airflow Data	Nominal Airflow		1900 cfm at 0.7 in. w.c.			2600 cfm at 0.95 in. w.c.			3100 cfm at 0.9 in. w.c.		
	EATR - Exhaust Air Transfer Ratio	at minus 1 in. w. c.	6.10%			6.10%			4.90%		
		at 0 in. w.c.	4.00%			4.00%			1.30%		
		at 1 in. w.c.	0.00%			0.00%			0.30%		
		OACF - Outdoor Air Correction Factor	at minus 1 in. w. c.	0.98%			0.98%			0.99%	
	at 0 in. w.c.		1.13%			1.13%			1.07%		
	at 1 in. w.c.		1.23%			1.23%			1.12%		
	¹ Thermal Ratings at 0 in. w.c. Pressure Differential		Total Effectiveness	100% Airflow Heating	Sensible	Latent	Total	Sensible	Latent	Total	Sensible
75% Airflow Heating		68%		60%	65%	68%	60%	65%	68%	60%	65%
100% Airflow Cooling		74%		67%	71%	74%	67%	71%	74%	67%	71%
75% Airflow Cooling		68%		60%	63%	68%	60%	63%	68%	60%	63%
Net Effectiveness		100% Airflow Heating	74%	67%	70%	74%	67%	70%	74%	67%	70%
		75% Airflow Heating	68%	60%	65%	68%	60%	65%	68%	60%	65%
		100% Airflow Cooling	74%	67%	71%	74%	67%	71%	74%	67%	71%
		75% Airflow Cooling	68%	60%	63%	68%	60%	63%	68%	60%	63%
		100% Airflow Heating	74%	67%	70%	74%	67%	70%	74%	67%	70%
		75% Airflow Heating	68%	60%	65%	68%	60%	65%	68%	60%	65%
		100% Airflow Cooling	74%	67%	71%	74%	67%	71%	74%	67%	71%
		75% Airflow Cooling	68%	60%	63%	68%	60%	63%	68%	60%	63%
³ Weights	Fixed	Shipping Weight - lbs.	811			811			1120		
		Net Weight - lbs.	726			726			1045		
	Pivoting	Shipping Weight - lbs.	928			928			1125		
		Net Weight - lbs.	843			843			1050		

¹ Rated in accordance with AHRI Standard 1060-2005. For further information, please reference AHRI 1060-2005 Standard for Rating Air-to-Air Heat Exchangers For Energy Recovery Ventilation Equipment.

² A unit step-down transformer is provided, 208/230/460/575V primary, 120V secondary.

³ Actual weight may vary and is dependent on configuration.

SPECIFICATIONS				15 TO 25 TON XION MODELS (continued)										
General Data		Model Number Fixed Wheel		50R4648xH			50R6248xM			50R6248xH				
		Model Number Pivoting Wheel		50P4648xH			50P6248xM			50P6248xH				
		Nominal Air Volume - cfm		3400-4600			4800-5600			5500-6200				
		Matching Units		Xion 180 through 300 models										
Required Height of Rooftop Unit Curb - in.				24		24		24						
Fresh Air Blower		Belt-Drive Motor - hp		3		5		5						
		Wheel Size (diameter x width) - in		12 x 12		12 x 12		12 x 12						
		Motor Speed - rpm		1725		1725		1725						
		Motor Speed(s)		Adjustable Sheave		Adjustable Sheave		Adjustable Sheave						
		Bearing Type		Ball		Ball		Ball						
Exhaust Air Blower		Belt-Drive Motor - hp	Fixed Wheel	3		5		5						
			Pivoting Wheel	5		2 each - 5		2 each - 5						
		Wheel Size (diameter x width) - in		12 x 12		12 x 12		12 x 12						
		Motor Speed - rpm		1725		1725		1725						
		Motor Speed(s)		Adjustable Sheave		Adjustable Sheave		Adjustable Sheave						
		Bearing Type		Ball		Ball		Ball						
Recovery Wheel		Wheel Depth x Diameter - in		3 x 46-3/4		3 x 52		3 x 52						
		Motor Speed - rpm		1075		1075		1075						
Electrical Data - Line Voltage - 60Hz				208/230V-3ph, 460V-3ph, or 575V-3ph										
Enthalpy Wheel Airflow Data		Nominal Airflow		3900 cfm at 0.95 in. w.c.		5500 cfm at 0.95 in. w.c.		5500 cfm at 0.95 in. w.c.						
		EATR - Exhaust Air Transfer Ratio	at minus 1 in. w. c.	4.40%		4.00%		4.00%						
			at 0 in. w.c.	1.10%		1.00%		1.00%						
			at 1 in. w.c.	0.20%		0.20%		0.20%						
		OACF - Outdoor Air Correction Factor	at minus 1 in. w. c.	0.99%		0.99%		0.99%						
			at 0 in. w.c.	1.06%		1.06%		1.07%						
			at 1 in. w.c.	1.11%		1.10%		1.12%						
		¹ Thermal Ratings at 0 in. w.c. Pressure Differential				Sensible	Latent	Total	Sensible	Latent	Total	Sensible	Latent	Total
Total Effectiveness	100% Airflow Heating					68%	60%	65%	68%	60%	65%	68%	60%	65%
	75% Airflow Heating					73%	67%	71%	73%	67%	71%	73%	67%	71%
	100% Airflow Cooling					68%	60%	63%	68%	60%	63%	68%	60%	63%
	75% Airflow Cooling					73%	67%	70%	73%	67%	70%	73%	67%	70%
Net Effectiveness	100% Airflow Heating					68%	60%	65%	68%	60%	65%	68%	60%	65%
	75% Airflow Heating					73%	67%	71%	73%	67%	71%	73%	67%	71%
	100% Airflow Cooling					68%	60%	63%	68%	60%	63%	68%	60%	63%
	75% Airflow Cooling					73%	67%	70%	73%	67%	70%	73%	67%	70%
² Weights						Fixed	Shipping Weight - lbs.	1333			1566			1566
			Net Weight - lbs.	1224			1441			1441				
		Pivoting	Shipping Weight - lbs.	1339			1623			1623				
			Net Weight - lbs.	1230			1498			1498				

¹ Rated in accordance with AHRI Standard 1060-2005. For further information, please reference AHRI 1060-2005 Standard for Rating Air-to-Air Heat Exchangers For Energy Recovery Ventilation Equipment.

² Actual weight may vary and is dependent on configuration.

ELECTRICAL DATA

Model No.		² 50R0644xH	50R1144xH 50P1144xH	50R2044xH 50R2047xH	50P2044xH 50R2047xH	50R2847xM 50R2848xM 50R2847xH 50R2848xH	50P2847xM 50P2848xM 50P2847xH 50P2848xH
Fresh Air Blower Motor	115V-1ph	3.8	---	---	---	---	---
	208/230V-3ph	---	3.4	3.8	3.8	5.6	5.6
	460V-3ph	---	1.4	1.9	1.9	2.8	2.8
	575V-3ph	---	1.4	1.4	1.4	2.0	2.0
Exhaust Blower Motor	115V-1ph	3.8	---	---	---	---	---
	208/230V-3ph	---	3.4	3.8	5.6	5.6	9
	460V-3ph	---	1.4	1.9	2.8	2.8	4.4
	575V-3ph	---	1.4	1.4	2.0	2.0	3.6
Wheel Drive Motor - Full load amps		0.7	0.3	0.3	0.3	0.6	0.6
Maximum Overcurrent Protection (amps)	115V-1ph	10	---	---	---	---	---
	208/230V-3ph	9	10	12	15	20	25
	460V-3ph	4	6	6	8	10	12
	575V-3ph	3	6	5	6	7	10
¹ Minimum Circuit Ampacity	115V-1ph	9.3	---	---	---	---	---
	208/230V-3ph	5.4	8.0	8.9	11.1	13.2	17.5
	460V-3ph	2.7	3.5	4.6	5.7	6.9	8.9
	575V-3ph	2.2	3.5	3.5	4.2	5.1	7.1

¹ Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements.


² A unit step down transformer is provided, 208/230/460/575V primary, 120V secondary

ELECTRICAL DATA

Model No.		50R3647xH 50R3648xH	50P3647xH 50P3648xH	50R4648xH	50P4648xH	50R6248xM 50R6248xH	50P6248xM 50P6248xH
Fresh Air Blower Motor	208/230V-3ph	7.0	7.0	9	9	15	15
	460V-3ph	3.5	3.5	4.4	4.4	7.4	7.4
	575V-3ph	2.4	2.4	3.6	3.6	5.9	5.9
	Full load amps						
Exhaust Blower Motor	208/230V-3ph	7.0	9.4	9	15.3	15.3	15.3
	460V-3ph	3.5	4.3	4.3	6.4	6.4	6.4
	575V-3ph	2.4	3.2	3.4	5.1	5.1	5.1
	Full load amps						
Wheel Drive Motor - Full load amps		1.2	1.2	1.2	1.2	1.2	1.2
Maximum Overcurrent Protection (amps)	208/230V-3ph	25	25	30	40	50	50
	460V-3ph	12	15	15	20	25	25
	575V-3ph	10	12	12	15	20	20
	Full load amps						
¹ Minimum Circuit Ampacity	208/230V-3ph	17.0	20.0	21.5	29.4	35.4	35.4
	460V-3ph	9.0	10.0	11	13.6	16.9	16.9
	575V-3ph	6.6	7.6	9.1	11.2	13.7	13.7
	Full load amps						


¹ Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements.

DIMENSIONS

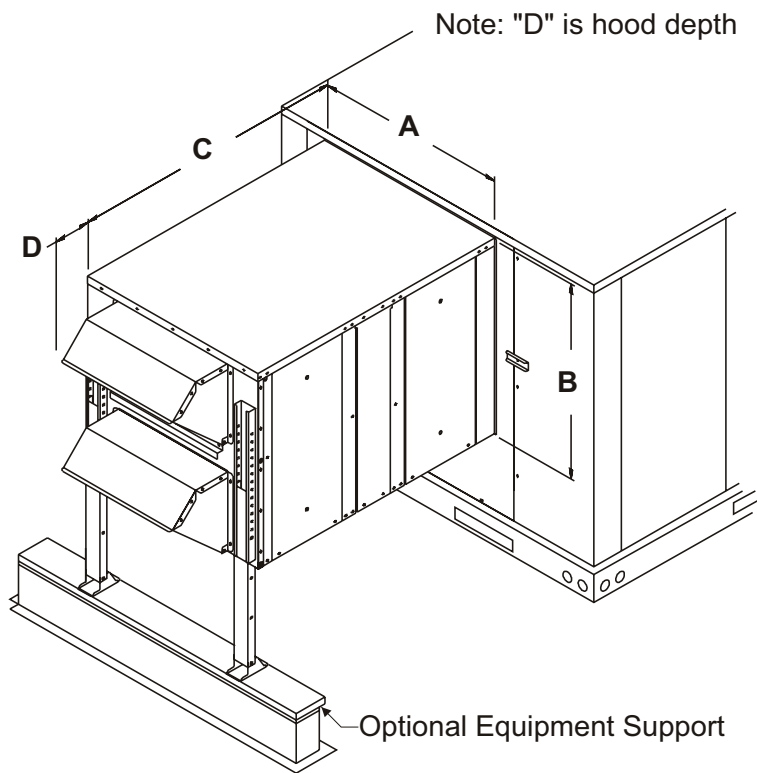


Model No.	Usage	A	B	C	D
50R0644xH	024-060	24-3/4 (629)	24-5/8 (625)	34-9/16 (876)	8 (203)
50R1144xH 50P1144xH		32-1/8 (816)	33-1/2 (851)	44-3/4 (1138)	11 (279)
50R2044xH 50P2044xH	074	37-1/4 (946)	37-1/2 (953)	54-3/8 (1381)	20-5/16 (516)
50R2047xH 50P2047xH	092-150				
50R2847xM 50P2847xH 50R2847xM 50P2847xH	092-150	42-5/8 (1083)	43-9/16 (1106)	52-1/4 (1327)	18-5/16 (465)
50R3647xH 50P3647xH	092-150	46-11/16 (1186)	57-3/8 (1457)	60 (1524)	18-5/16 (465)

Model No.	Usage	A	B	C	D
50R2848xM 50R2848xH 50P2848xM 50P2848xH	180-300	42-5/8 (1083)	43-9/16 (1106)	52-1/4 (1327)	18-5/16 (465)
50R3648xH 50P3648xH	180-300	46-11/16 (1186)	57-3/8 (1457)	60 (1524)	18-5/16 (465)
50R4648xH 50P4648xH	180-300	52-11/16 (1338)	57-3/8 (1457)	60 (1524)	18-5/16 (465)
50R6248xM 50R6248xH 50P6248xM 50P6248xH	180-300	58-7/8 (1496)	57-3/8 (1457)	60 (1524)	18-5/16 (465)

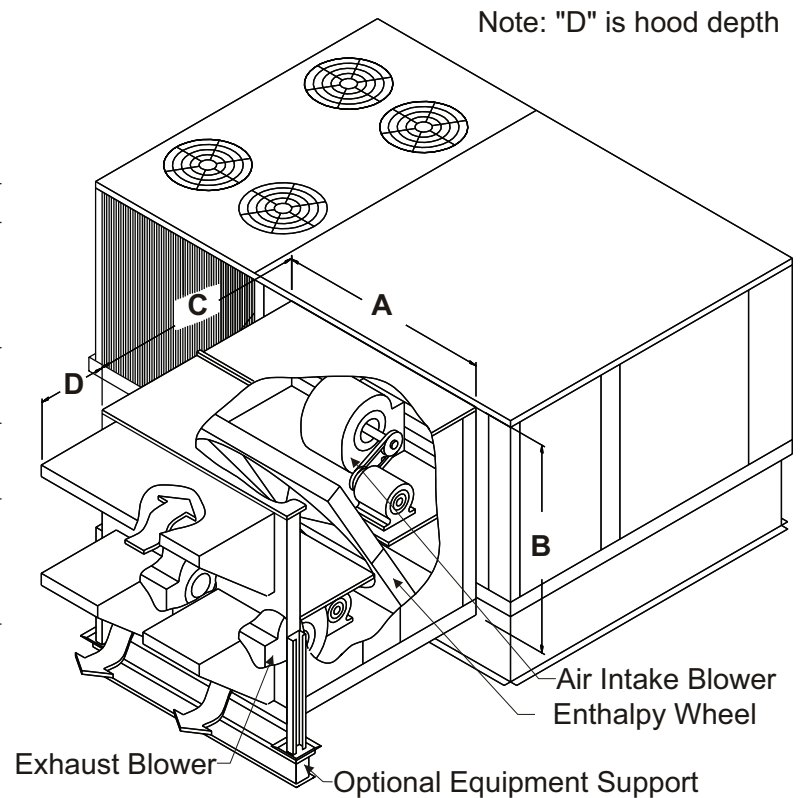


UNIT CLEARANCES

024 through 074 models

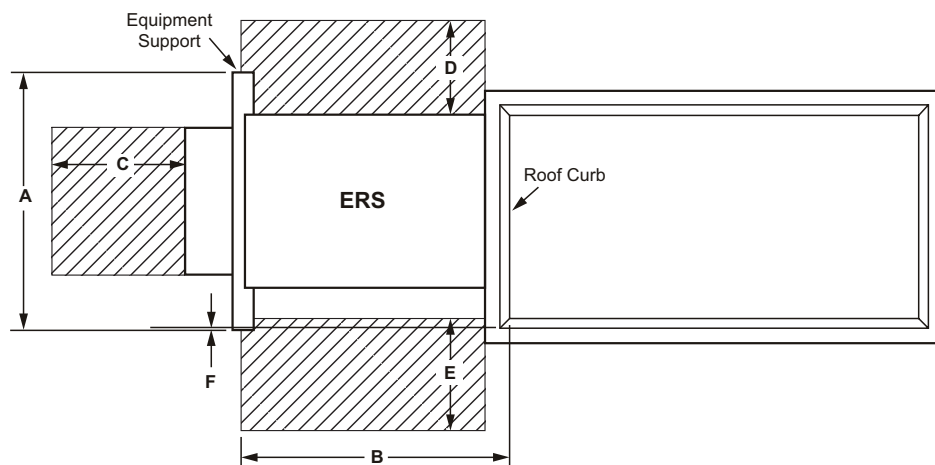


092 and 150 models

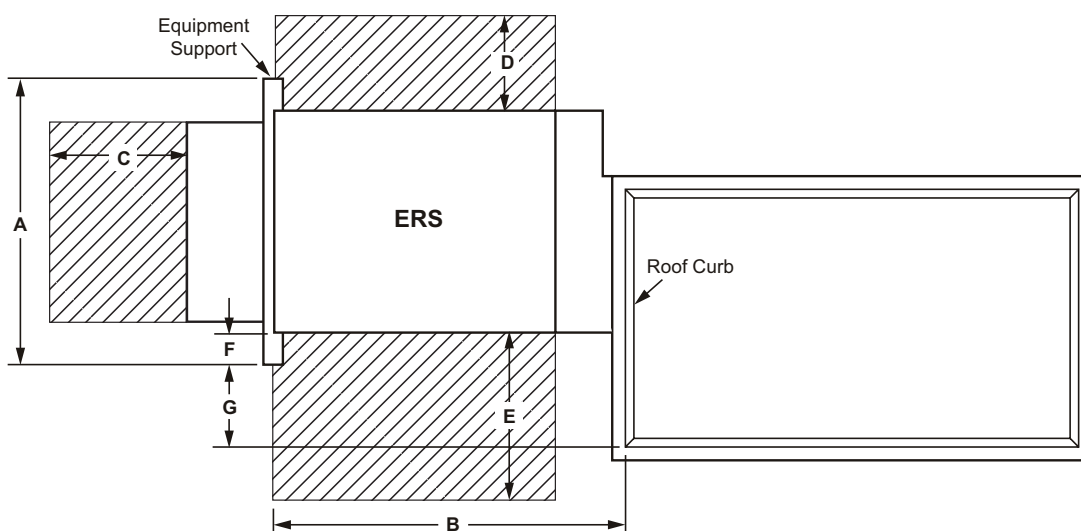

ERS Model No.	A		B		C		D		E		F		G	
	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm
024 thru 060 models														
50R0644xH	48	1219	39-3/8	1000	16	406	18	457	24	610	2	51	---	---
50R1144xH 50P1144xH	48	1219	49-1/2	1257	24	610	18	457	36	914	2	51	---	---
074 models														
50R2044xH 50P2044xH	48	1219	58-1/4	1480	40	1016	24	610	42	1067	2	51	---	---
092 thru 150 models														
50R2047xH 50P2047xH	48	1219	60-3/8	1533	40	1016	24	610	42	1067	5-3/8	137	18-5/8	473
50R2847xM 50R2847xH 50P2847xM 50P2847xM	60	1524	60-1/4	1530	36	914	24	610	48	1219	6-5/8	168	17-1/2	444
50R3647xH 50P3647xH	60	1524	70-1/2	1791	36	914	30	762	60	1524	6-5/8	168	17-1/2	444

UNIT CLEARANCES

180 through 300 models

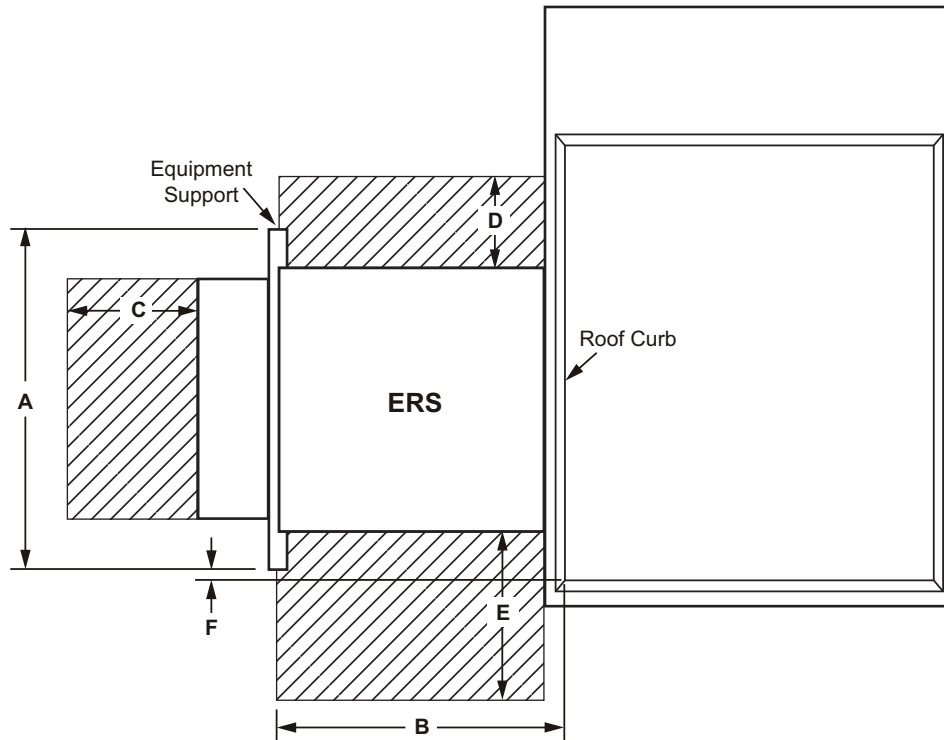

ERS Model No.	A		B		C		D		E		F	
	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm
180 thru 300 models												
50R2848xM 50R2848xH 50P2848xM 50P2848xH	60	1524	56-1/8	1426	36	914	24	610	48	1219	11-1/4	286
50R3648xH 50P3658xH	60	1524	63-7/8	1622	36	914	30	762	60	1524	11-1/4	286
50R4648xH 50P4648xH	76	1930	63-7/8	1622	36	914	30	762	60	1524	3-1/8	79
50R6248xM 50R6248xH 50P6248xM 50P6248xH	76	1930	63-7/8	1622	36	914	30	762	60	1524	3-1/8	79

GUIDE SPECIFICATIONS

Prepared for the guidance of architects, consulting engineers and mechanical contractors.

General

- Unit shall be a constant volume, energy recovery system used in conjunction with packaged rooftop equipment
- Unit shall be directly coupled to the rooftop packaged unit to form a unitized system
- Unit shall be performance rated in accordance with AHRI standards and in compliance with ASHRAE or DOE standards
- Unit shall be certified to the applicable safety standards for the installed country
- In addition, manufacturer shall test operate system at the factory before shipment

Approval

- All models shall be certified in accordance with AHRI Standard 1060-2005, Air-to-Air Energy Recovery Ventilation Equipment and Standard for Safety for Heating and Cooling Equipment ANSI/UL1995, CAN CSA - 22.2 No. 236-05

Equipment Warranty

- Energy Recovery wheel shall have a limited warranty for five years
- All other covered components have a limited warranty for one year

Cabinet

- Shall be designed to attach directly to the rooftop unit.
- Shall be constructed of G90 galvanized steel with a powdered enamel paint finish electro-statically bonded to the metal
- Metal shall be salt spray tested for 1000 hours per ASTM B-117
- Cabinet panels shall be fully insulated with non-hygroscopic fiberglass insulation. Insulation shall have an R-Value of 3. 7 and shall be flame resistant per UL-723. Insulation shall be in accordance with NFPA 90A and tested to meet UL 181 erosion requirements
- Full perimeter base rail with top mounted rigging holes and fork truck access from three sides shall be provided
- Test ports shall be provided so airflow can be measured across the energy recovery wheel

Energy Recovery Wheel Types

- Wheel shall be either of the enthalpy type for both sensible and latent heat recovery or the sensible type for sensible heat recovery
- Energy transfer ratings shall be certified in accordance with AHRI Standard 1060-2000.
- Wheel shall be constructed of a lightweight polymer material
- Enthalpy type shall be coated with a desiccant silica gel that will not dissolve or liquefy in the presence of water or high humidity
- All energy recovery wheels shall be designed to be removed from the unit for ease of inspection and maintenance, 25 inch and larger wheels shall be segmented for easy removal
- The wheel shall be easily cleanable with standard coil cleaning solution
- The wheel shall be available in both fixed and pivoting configurations

Performance

- The complete line of units shall have a cfm range of 300 to 6200
- Individual units shall be available in ranges of 300 550, 700-1000, 1000-1700, 1500-2200, 2200-2800, 2800-3600, 3400-4600, 4800-5600, and 5500-6200 cfm
- Unit shall operate to 10oF without the need for frost protection
- Unit shall have up to 73% net effectiveness per AHRI tests. Application effectiveness shall be higher

Control Operation

- Operation shall be controlled by a low voltage logic board
- Logic board shall control low ambient kit and motorized outside air damper

Access Doors

- All components shall be accessible through removable access doors as a standard option

Filters

- All unit shall be provided with mist eliminator type filters in the intake air hood
- Optional internal MERV 8 pleated filters provided with filter racks

Blowers

- Intake/exhaust air blowers shall be direct drive on ERS of 1000 cfm or less
- Belt drive intake/exhaust air blowers shall be used on ERS over 1000 cfm

GUIDE SPECIFICATIONS

Motors

- Blower motors on belt drive ERS shall have permanently lubricated ball bearings. Motors shall have thermal overload protection and shall have adjustable sheaves for blower speed adjustment.
- Blower motors on direct drive ERS shall be PSC type with multiple speeds.
- Intake and exhaust motors shall be individually controlled.
- Motor efficiency shall meet requirements of U.S. Energy Policy Act of 1992 (EPACT).

Electrical

- Units shall have single power point connection.
- A low voltage terminal strip shall be available.

Balancing Dampers

- Shall be provided for all fixed wheel units and shall be mounted inside the rooftop unit.

Barometric Relief Dampers

- Pressure operated dampers shall be provided for all ERS units.

Options / Accessories

Low Ambient Kit

- Low Ambient Kit shall be factory installed to prevent frost formation on the energy recovery wheel.
- Frost is prevented controlling the intake blower operation when discharge temperature is below a selectable temperature setting.

Motorized Outside Air Damper Assembly with Hood

- Shall be factory installed to provide motorized operation of intake air requirements.
- Damper assembly shall be installed behind the ERS outside air intake hood.

Motorized Exhaust Air Damper

- Shall be factory installed to provide motorized operation of exhaust air requirements.
- Damper assembly shall be install in the ERS barometric relief hood.

Stop-Start-Jog

- Shall be a factory installed option for fixed wheel units only. Matching rooftop unit should not have an economizer.

Pressure Sensor

- Shall be a factory installed option to provide the amount of outside airflow across the enthalpy wheel.

Rotation Sensor

- Shall be a factory installed option to verifies the rotation of the enthalpy wheel.

Disconnect

- Shall be factory installed and field wired to provide easy ability to turn power on/off to the ERS

VFD

- Shall be factory installed to provide variable frequency drive to control the speed of the blowers only.

Dirty Filter Sensor

- Shall be factory installed to provide a sensor to signal a field installed alarm when the filters need to be cleaned or changed.

Filter Rack

- Shall be factory installed with 2" MERV 8 pleated filters to filter air in both the intake and exhaust sections of the ERS.

Optional Energy Recovery Wheel

- Optional wheel shall be the sensible type for sensible heat recovery.
- Energy transfer ratings shall be certified in accordance with AHRI Standard 1060-2000.
- Wheel shall be constructed of a lightweight polymer material.
- All energy recovery wheels shall be designed to be removed from the unit for ease of inspection and maintenance, 25 inch and larger wheels shall be segmented for easy removal.
- The wheel shall be easily cleanable with standard coil cleaning solution.
- The wheel shall be available in both fixed and pivoting configurations.

GFI Service Outlet

- Shall be field installed and field wired to provide powered service outlet.

ERS Equipment Support

- Shall be field installed to provide support of the exhaust and intake end of the ERS.
- Supports are available in 48, 60, and 76 inch lengths.

ERS Roof Curb

- Shall be field installed to provide support of the RTU and raise them to the correct height for mounting.

OPTIONS / ACCESSORIES - ORDER SEPARATELY

Model No.	Fixed Wheel	50R0644xH 50R1144xH 50R2044xH	50R2047xH 50R2847xM 50R2847xH	50R2848xM 50R2848xH	50R3647xH	50R3648xH	50R4648xH	50R6248xM 50R6248xH
	Pivot Wheel	50P1144xH 50P2044xH	50P2047xM 50P2047xH 50P2847xM 50P2847xH	50P2848xM 50P2848xH	50P3647xH	50P3648xH	50P4648xH	50P6248xM 50P6248xH
Dirty Filter Sensor		O	O	O	O	O	O	O
² Disconnect		O	O	O	O	O	O	O
Energy Recovery Wheel - Sensible		O	O	O	O	O	O	O
Filter Rack		O	O	O	O	O	O	O
² GFI Service Outlet		X	X	X	X	X	X	X
Low Ambient Kit		O	O	O	O	O	O	O
Motorized Exhaust Air Damper Kit		O	O	O	O	O	O	O
Motorized Outdoor Air Damper Kit		O	O	O	O	O	O	O
Pressure Sensor Kit		O	O	O	O	O	O	O
¹ Stop-Start-Jog Kit		O	O	O	O	O	O	O
ERS Roof Curb	502014414	X						
	502014614							
	502014714		X					
	502014724				X			
	502013214			X				
	502013224					X	X	X
ERS Equipment Support	012104808	X						
	012106008		X	X	X	X		
	012107608						X	X
Rotation Sensor		O	O	O	O	O	O	O
VFD		O	O	O	O	O	O	O

O - Configure to Order (Factory Installed)

X - Field Installed.

¹ Available on Fixed Wheel models only.

² Must be Field Wired



Visit us at www.Lennox.com

For the latest technical information, www.LennoxCommercial.com

Contact us at 1-800-4-LENNOX

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability.
Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury.
Installation and service must be performed by a qualified installer and servicing agency.

©2022 Lennox Industries, Inc.